SYRACUSE UNIVERSITY DAY HALL

2015 RESIDENCE HALL FIRE SAFETY REPORT	
Building Name: Day Hall	**Address:** 300 Mt. Olympus Dr.
Building Size: 8 floors plus basement and elevator penthouse, 7 exits	**Building Capacity:** 607

FIRE PROTECTION SYSTEMS	
Sprinkler System: Wet system throughout building including 100% of student rooms; 2 pre-action dry systems cover the electrical vault and the elevator mechanical room.	
Fire Pump: 1,000 GPM Electric Flow Meter	Fire Alarm Control Panel: FCI-FCID
Addressable Pull Stations: 59	Spk. Supervisory: 32
Photo-Electric Smoke Detectors: 208	Water Flow Switches: 20
Heat Detectors: 35	Roof Hatches: 4
Duct Detectors: 0	Fire Shutters/Louvers: 0
Alarm: Horns w/Visual: 75	Beam Detectors: 0
Fire Extinguishers: 46	Alarm System Type: Campus Tie
Ansul Systems: 0	Inspections Requirements: NFPA 72 (1 thru 7)

INSPECTION, TESTING, & MAINTENANCE				
Evacuation Drills:	2/17/15	3/30/15	10/6/15	11/4/15
Smoke Detection Certification:	5/13/15			
NYS Office of Fire Prevention and Control Inspection: 9/28/15				

FIRE ALARMS			
Date	Cause	Date	Cause
1/5/15	Unknown	4/10/15	Accidental
4/11/15	Accidental	4/21/15	Accidental
5/15/15	Contractors	5/18/15	Contractors
5/21/15	Unknown	5/29/15	Contractors
10/23/15	Cooking	11/4/15	Cooking
11/6/15	Dust		

Fire and Life Safety Services Office, 029 Lyman Hall, Syracuse, New York 13244-1270
315-443-5474 / Fax: 315-443-5288

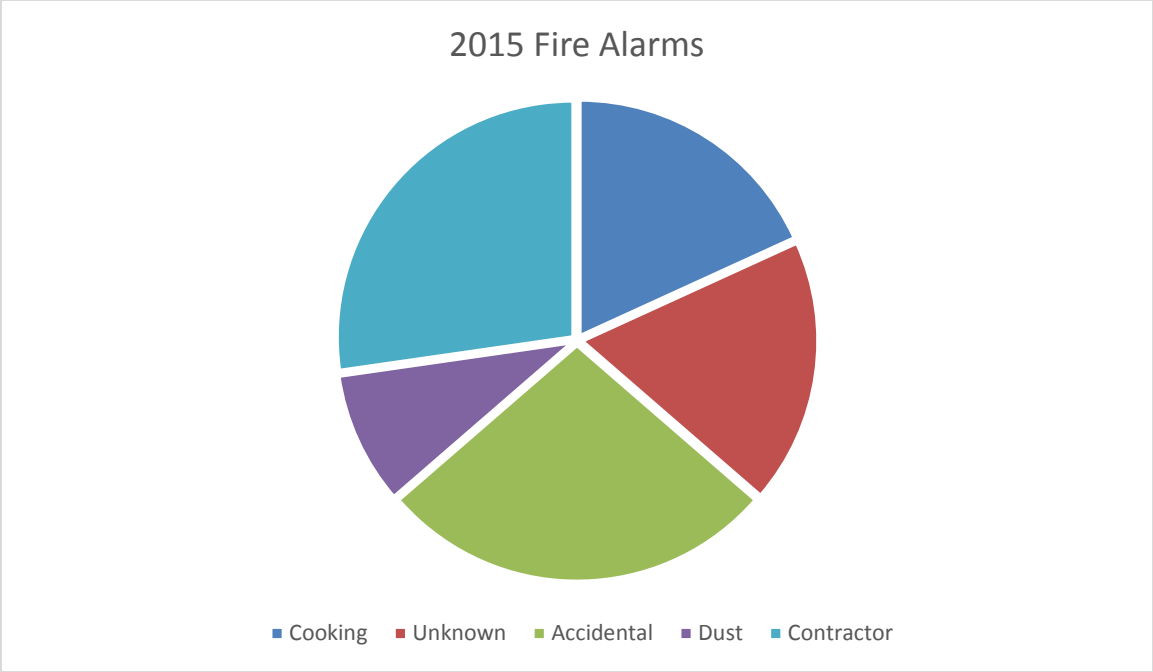
2015 Fire Alarms
Cooking
Unknown
Accidental
Dust
Contractor