



SYRACUSE UNIVERSITY BREWSTER HALL



2015 RESIDENCE HALL FIRE SAFETY REPORT

Building Name: Brewster Hall	Address: 401 Van Buren St
Building Size: 13 floors plus basement and sub-basement, 5 exits	Building Capacity: 444

FIRE PROTECTION SYSTEMS

Sprinkler System: Wet system throughout building including 100% of student rooms; 2 pre-action dry systems cover the electrical vault and the elevator mechanical room	
Fire Pump: 1,000 GPM Electric Flow Meter	Fire Alarm Control Panel: EST-3
Addressable Pull Stations: 38	Spk. Supervisory: 27
Photo-Electric Smoke Detectors: 163	Water Flow Switches: 20
Heat Detectors: 24	Roof Hatches: 0
Duct Detectors: 3	Fire Shutters/Louvers: 0
Alarm: Horns w/Visual: 66	Beam Detectors: 0
Fire Extinguishers: 41	Alarm System Type: Campus Tie
Ansul Systems: 0	Inspections Requirements: NFPA 72 (1 thru 7)


INSPECTION, TESTING, & MAINTENANCE

Evacuation Drills:	2/19/15	4/3/15	10/6/15	11/4/15
Smoke Detection Certification:	5/12/15			
NYS Office of Fire Prevention and Control Inspection: 10/14/15				

FIRE ALARMS

Date	Cause	Date	Cause
2/7/15	Cooking	2/13/15	Sprinkler
2/25/15	Malicious	3/5/15	Unknown
3/15/15	Unknown	4/10/15	Unknown
5/3/15	Unknown	10/11/15	Unknown
12/3/15	Cooking		

2015 Fire Alarms

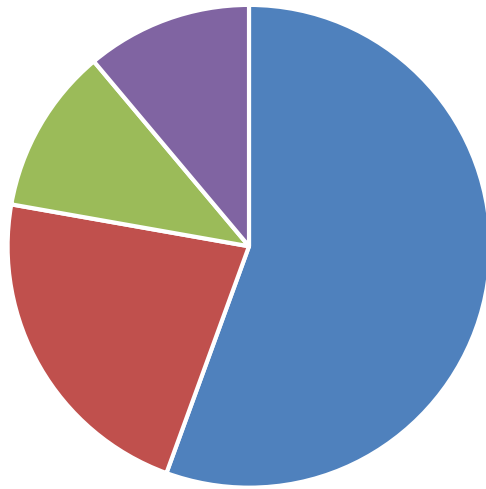

■ Unknown ■ Cooking ■ Accidental ■ Malicious