



SYRACUSE UNIVERSITY DELLPLAIN HALL



2015 RESIDENCE HALL FIRE SAFETY REPORT

Building Name: Dellplain Hall	Address: 601 Comstock Ave
Building Size: 9 floors plus basement, 5 exits	Building Capacity: 436

FIRE PROTECTION SYSTEMS

Sprinkler System: **Wet system throughout building including 100% of student rooms; 2 pre-action dry systems cover the electrical vault and the elevator mechanical room.**

Fire Pump: 1,000 GPM Electric Flow Meter	Fire Alarm Control Panel: EST-3
Addressable Pull Stations: 34	Spk. Supervisory: 26
Photo-Electric Smoke Detectors: 197	Water Flow Switches: 20
Heat Detectors: 28	Roof Hatches: 0
Duct Detectors: 0	Fire Shutters/Louvers: 0
Alarm: Horns w/Visual - 54	Beam Detectors: 0
Fire Extinguishers: 33	Alarm System Type: Campus Tie
Ansul Systems: 0	Inspections Requirements: NFPA 72 (1 thru 7)


INSPECTION, TESTING, & MAINTENANCE

Evacuation Drills:	2/23/15	3/27/15	10/7/15	11/2/15
Smoke Detection Certification:	5/14/15			
NYS Office of Fire Prevention and Control Inspection: 10/16/15				

FIRE ALARMS

Date	Cause	Date	Cause
1/18/15	Cooking	1/19/15	Cooking
1/28/15	Cooking	2/14/15	Unknown
2/28/15	Cooking	4/5/15	Cooking
4/25/15	Unknown	6/29/15	Unknown
8/30/15	Cooking	9/27/15	Cooking
10/7/15	Cooking	10/12/15	Cooking
10/21/15	Cooking	10/31/15	Cooking
11/1/15	Cooking	11/29/15	Cooking
12/11/15	Unknown	12/12/15	Cooking

2015 Fire Alarms

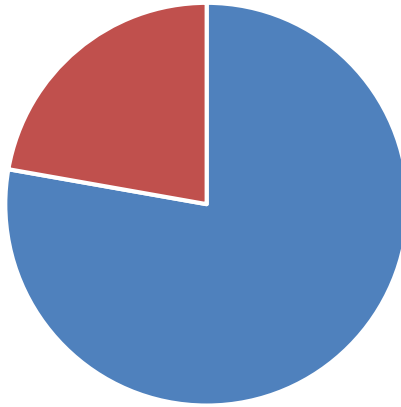

■ Cooking ■ Unknown