



# SYRACUSE UNIVERSITY FLINT HALL



## 2015 RESIDENCE HALL FIRE SAFETY REPORT

<b>Building Name:</b> Flint Hall	<b>Address:</b> 100 Mt. Olympus Dr.
<b>Building Size:</b> 4 floors plus basement, 11 exits	<b>Building Capacity:</b> 551

### FIRE PROTECTION SYSTEMS

Sprinkler System: **Wet system throughout building including 100% of student rooms; 2 pre-action dry systems cover the electrical vault and the elevator mechanical room.**

Fire Pump: 1,000 GPM Electric Flow Meter	Fire Alarm Control Panel: EST-3
Addressable Pull Stations: 41	Spk. Supervisory: 31
Photo-Electric Smoke Detectors: 157	Water Flow Switches: 26
Heat Detectors: 33	Roof Hatches: 0
Duct Detectors: 0	Fire Shutters/Louvers: 0
Alarm: Horns w/Visual - 85	Beam Detectors: 0
Fire Extinguishers: 36	Alarm System Type: Campus Tie
Ansul Systems: 0	Inspections Requirements: NFPA 72 (1 thru 7)


### INSPECTION, TESTING, & MAINTENANCE

Evacuation Drills:	2/17/15	3/27/15	10/5/15	11/3/15
Smoke Detection Certification:	5/12/15			
NYS Office of Fire Prevention and Control Inspection: 9/28/15				

### FIRE ALARMS

Date	Cause	Date	Cause
2/12/15	Cooking	5/6/15	Contractor
9/7/15	Cooking	9/8/15	Malicious
10/8/15	Cooking	11/15/15	Cooking
12/7/15	Steam		

## 2015 Fire Alarms

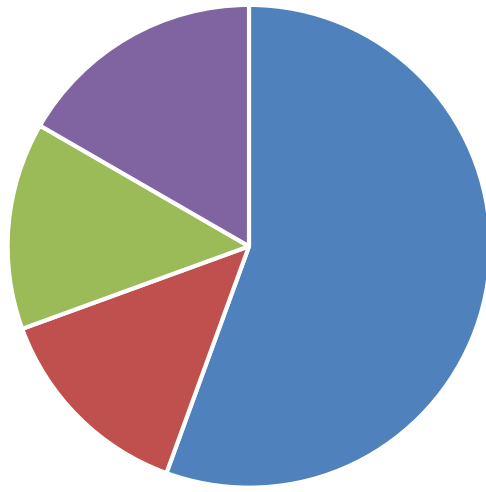

■ Cooking ■ Steam ■ Malicious ■ Contractor