



SYRACUSE UNIVERSITY WASHINGTON ARMS



2015 RESIDENCE HALL FIRE SAFETY REPORT

Building Name: Washington Arms	Address: 621 Walnut Ave.
Building Size: 6 floors, 3 exits	Building Capacity: 63

FIRE PROTECTION SYSTEMS

Sprinkler System: Wet system throughout building including 100% of student rooms.	
Fire Pump: 1,000 GPM Electric Flow Meter	Fire Alarm Control Panel: EST-2
Addressable Pull Stations: 12	Spk. Supervisory: 5
Photo-Electric Smoke Detectors: 24	Water Flow Switches: 3
Heat Detectors: 15	Roof Hatches: 0
Duct Detectors: 0	Fire Shutters/Louvers: 0
Alarm: Horns w/Visual – 10	Beam Detectors: 0
Fire Extinguishers: 12	Alarm System Type: Campus Tie
Ansul Systems: 0	Inspections Requirements: NFPA 72 (1 thru 7)


INSPECTION, TESTING, & MAINTENANCE

Evacuation Drills:	2/19/15	3/27/15	10/6/15	11/5/15
Smoke Detection Certification:	5/15/15			
NYS Office of Fire Prevention and Control Inspection: 10/14/15				

FIRE ALARMS

Date	Cause	Date	Cause
3/28/15	Cooking	4/1/15	Unknown
9/8/15	Cooking		

2015 Fire Alarms

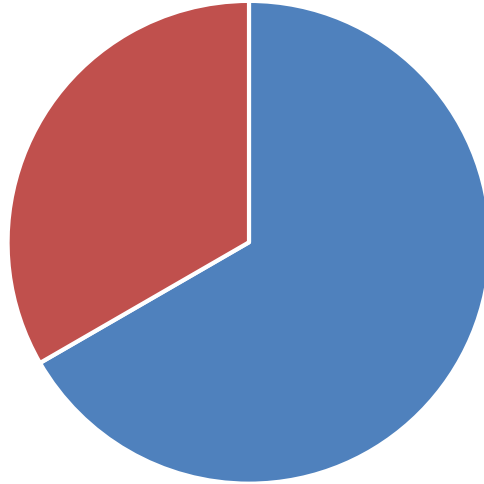

■ Cooking ■ Unknown