



SYRACUSE UNIVERSITY WATSON HALL



2015 RESIDENCE HALL FIRE SAFETY REPORT

Building Name: Watson Hall	Address: 403 University Pl.
Building Size: 5 floors plus basement, 17 exits	Building Capacity: 448

FIRE PROTECTION SYSTEMS

Sprinkler System: Wet system throughout building including 100% of student rooms.	
Fire Pump: 1,000 GPM Electric Flow Meter	Fire Alarm Control Panel: FCI
Addressable Pull Stations: 41	Spk. Supervisory: 34
Photo-Electric Smoke Detectors: 189	Water Flow Switches: 31
Heat Detectors: 11	Roof Hatches: 4
Duct Detectors: 6	Fire Shutters/Louvers: 0
Alarm: Horns w/Visual – 232	Beam Detectors: 0
Fire Extinguishers: 60	Alarm System Type: Campus Tie
Ansul Systems: 0	Inspections Requirements: NFPA 72 (1 thru 7)


INSPECTION, TESTING, & MAINTENANCE

Evacuation Drills:	2/26/15	3/24/15	10/7/15	11/4/15
Smoke Detection Certification:	5/11/15			
NYS Office of Fire Prevention and Control Inspection: 10/8/15				

FIRE ALARMS

Date	Cause	Date	Cause
2/17/15	Unknown	4/9/15	Malicious
4/25/15	Malicious	5/16/15	Unknown
5/21/15	Unknown	5/21/15	Contractor
5/27/15	Contractor	6/15/15	Contractor
6/25/15	Contractor	11/4/15	Electrical
12/20/15	Malicious		

2015 Fire Alarms

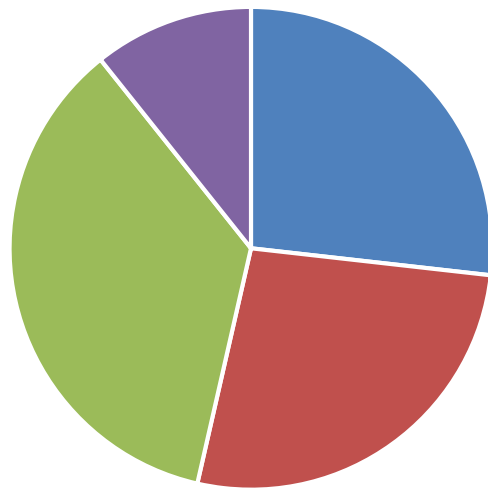

■ Unknown ■ Malicious ■ Contractor ■ Electrical